



SINGLE FAMILY FIRE PREVENTION INSTALLATION

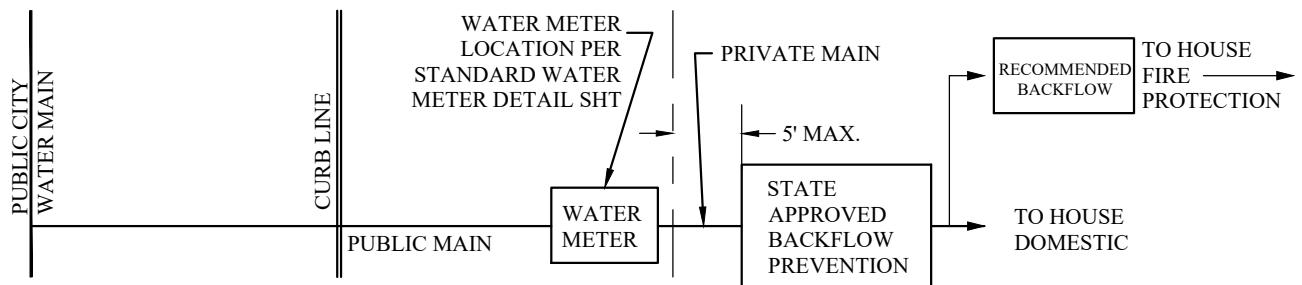

COMMERCIAL/MULTI-FAMILY BACKFLOW PREVENTION INSTALLATION

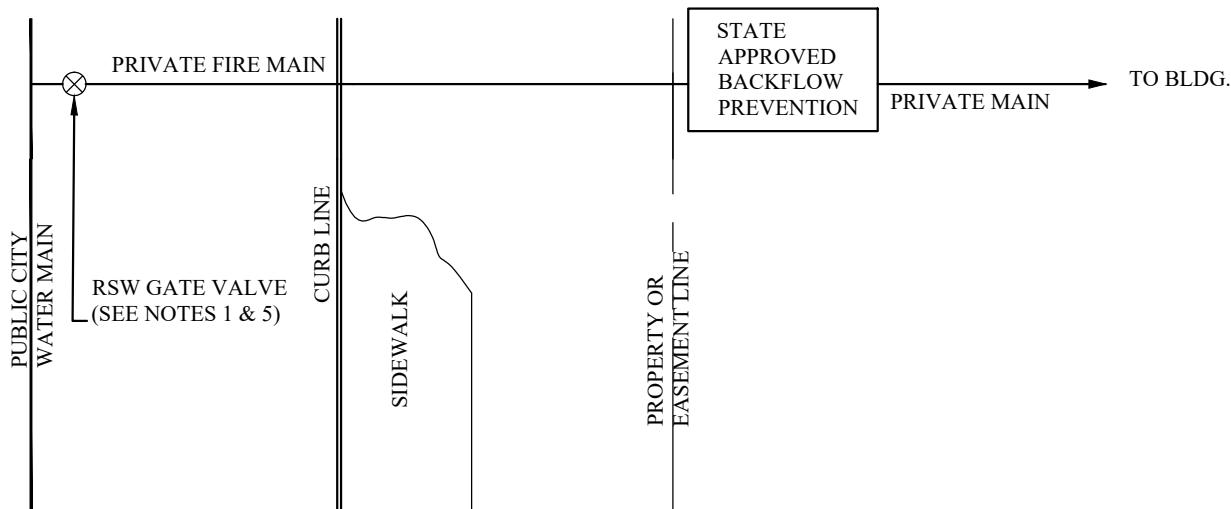

NOTES:

1. ALL STAND ALONE FIRE PROTECTION SERVICES (F.P.S.) SHALL HAVE A 4" OR LARGER IRON BODY GATE VALVE. VALVES SHALL BE LOCATED AT THE CONNECTION TO THE WATER MAIN.
2. FIRE PROTECTION SERVICES 2" AND SMALLER SHALL BE TYPE "K" COPPER AND F.P.S. LARGER THAN 2" SHALL BE 4" OR LARGER DUCTILE IRON PIPE.
3. ALL BACKFLOW DEVICES SHALL BE PER APPROVED PLAN.
4. ALL COMMERCIAL FIRE PROTECTION SERVICES SHALL BE PRIVATELY OWNED AND MAINTAINED DOWNSTREAM OF THE ROW OR EASEMENT.
5. REQUESTS FOR EXCEPTIONS TO THESE REQUIREMENTS MAY BE SUBMITTED IN WRITING WITH THE PLAN VIEW TO WATER DEPARTMENT, CROSS CONNECTION PROGRAM MANAGER.
6. ALL BACKFLOW DEVICES ARE PRIVATELY OWNED, TESTED AND MAINTAINED.
7. SINGLE FAMILY WATER METERS SHALL BE SIZED TO MEET THE REQUIRED FIRE FLOW.
8. PER RCW CHAPTER 70.119A.210, THE CITY OF WASHOUGAL SHALL NOT BE LIABLE FOR DAMAGES RESULTING FROM THE SHUTDOWN OF SINGLE FAMILY SERVICES DUE TO ROUTINE MAINTENANCE, NONPAYMENT; OR WATER SYSTEM EMERGENCIES.
9. ALL FIRE PROTECTION SERVICES, EXCEPT SINGLE FAMILY APPLICATIONS, SHALL BE TAPPED SEPARATELY FROM ALL DOMESTIC SERVICES AND FIRE HYDRANT LEADS.



STANDARD FIRE PROTECTION BACKFLOW LOCATION

DATE: December 2016

DETAIL
NO.
W161