

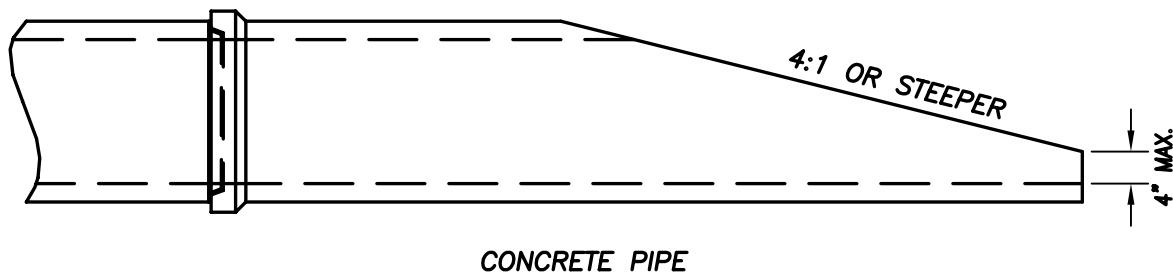


END SECTION OF THE PIPE SHALL BE SIX TIMES THE DIAMETER OF THE PIPE

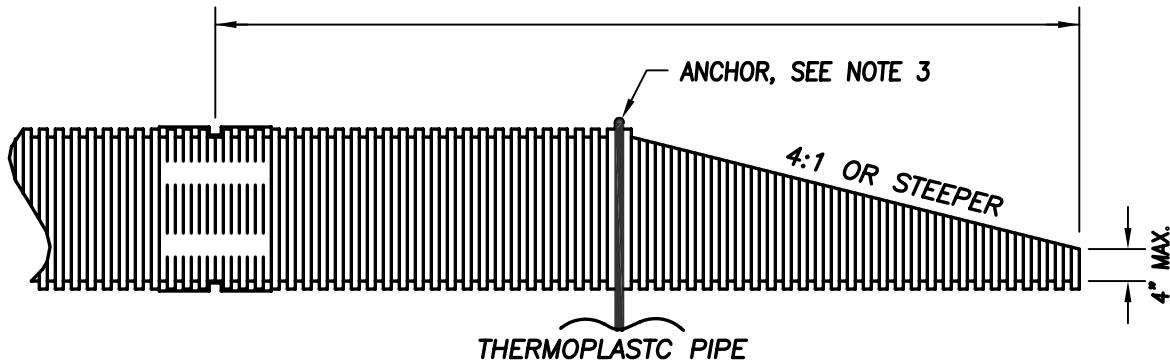

CONCRETE PIPE

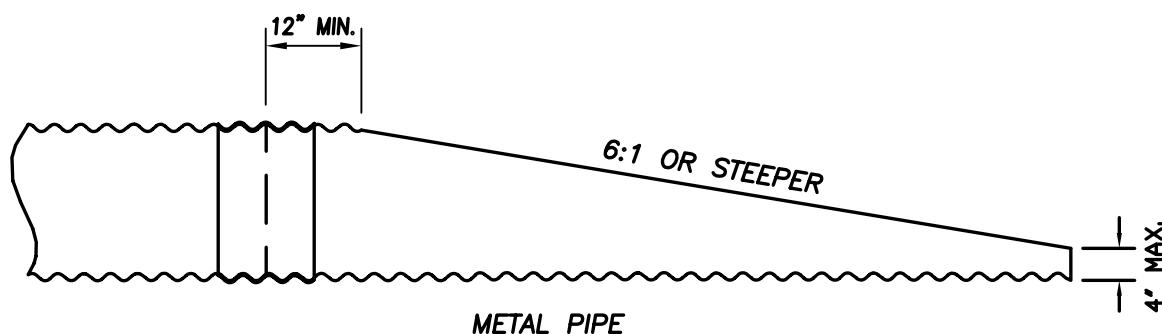

METAL PIPE

NOTES:

1. THE CULVERT ENDS SHALL BE BEVELED TO MATCH THE EMBANKMENT OR DITCH SLOPE, WITHOUT EXCEEDING THE LIMITS SHOWN ON THE PLAN.
2. FIELD CUT OF CULVERT ENDS IS PERMITTED, WHEN APPROVED BY THE CITY. ALL FIELD CUT PIPE CULVERTS SHALL BE TREATED WITH TREATMENT SHOWN IN THE STANDARD SPECIFICATION OR GENERAL SPECIAL PROVISIONS.
3. THE END OF THERMOPLASTIC PIPE SHALL BE ANCHORED.
4. FOR PIPES 18" OR LARGER, TRASH SCREEN REQUIRED.

BEVELED END CULVERT SECTION
NTS