
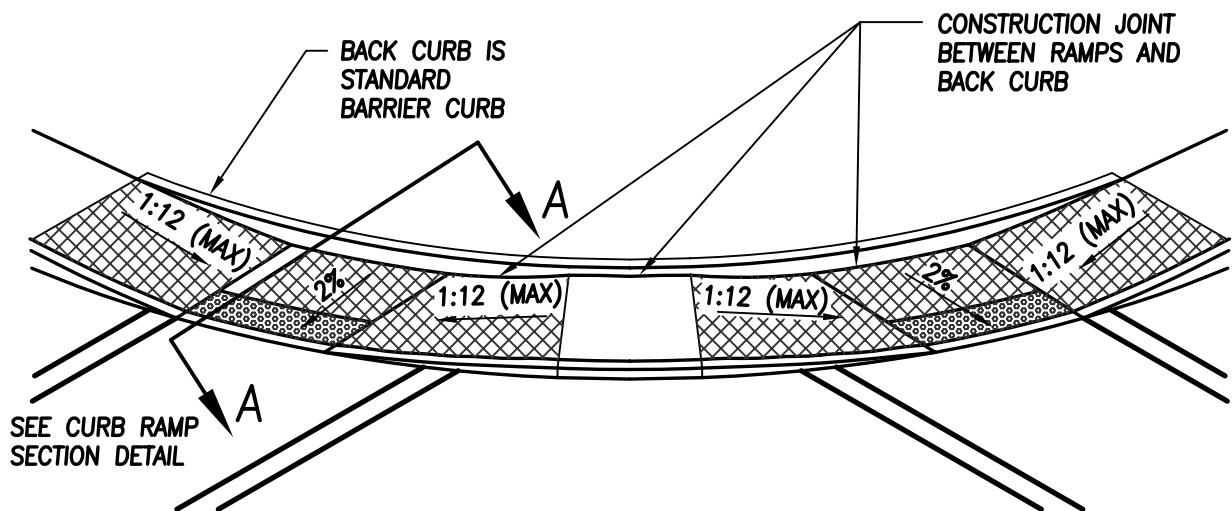


NOTES:

1. EXISTING CURB, GUTTER, AND SIDEWALK TO BE SAWCUT AND REMOVED FOR INSTALLATION OF NEW RAMP.
2. RAMPS TO BE POURED SEPARATELY FROM SIDEWALK.
3. 6" BACK CURB OUTSIDE OF SIDEWALK (CAN BE INSTALLED INSIDE IF ROW LINE IS BACK OF SIDEWALK). BACK CURB IS STANDARD BARRIER CURB.
4. CURB EXPOSURE MAY BE LESS THAN 6" TO MAINTAIN 3' MIN WIDTH OF SIDEWALK AREA.

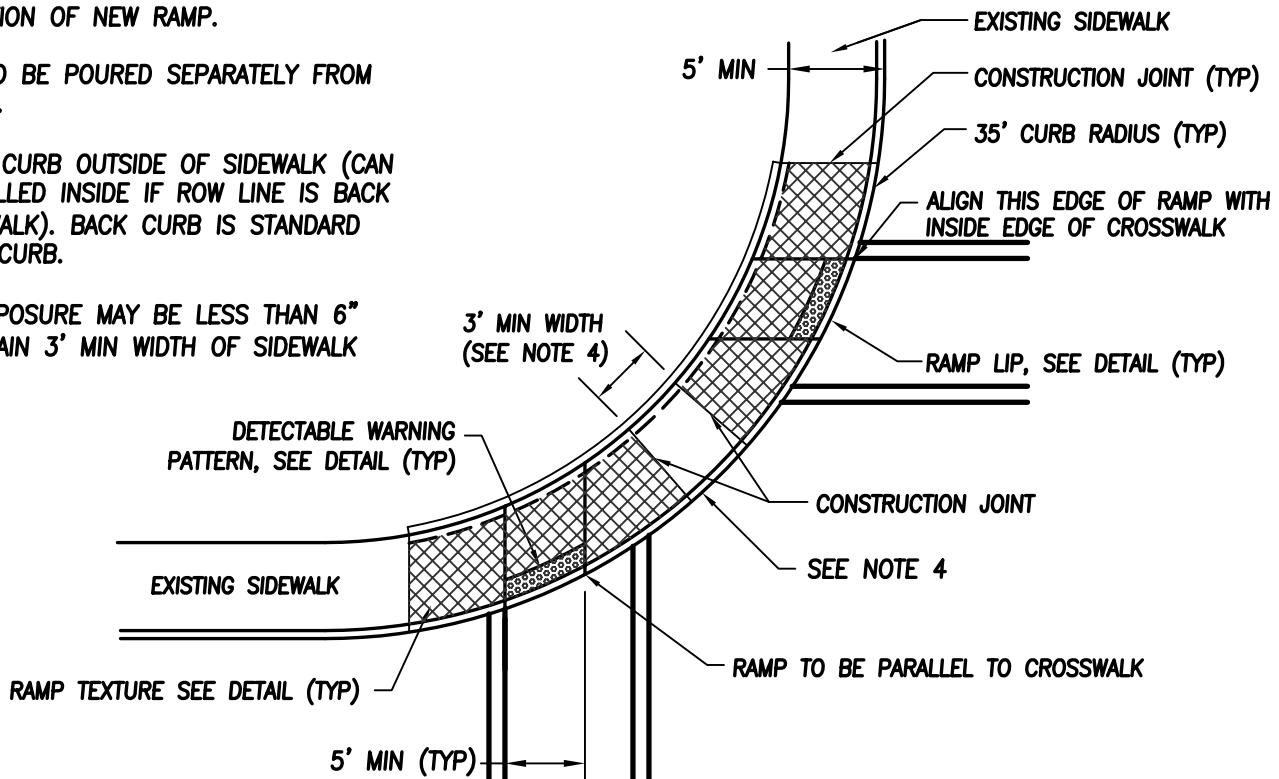

CURB RAMP – TYPE 1  
NTS