


**NOTES:**

1. RAMPS TO BE POURED SEPARATELY FROM SIDEWALK.
2. RAMP TO BE CENTERED IN CROSSWALK.
3. RAMP RUNS TO BE 1:12 (MAX) SLOPE UNLESS LENGTH WOULD EXCEED 8 FEET, THEN 8' LENGTH GOVERNS.
4. BACK CURB IS STANDARD BARRIER CURB.
5. 6" WIDE BACK CURB OUTSIDE OF SIDEWALK (INSTALL CURB INSIDE IF ROW LINE IS BACK OF SIDEWALK). BACK CURB IS STANDARD BARRIER CURB.
6. EXISTING CURB, GUTTER, AND SIDEWALK TO BE SAWCUT AND REMOVED FOR INSTALLATION OF NEW RAMP.

BACK CURB IS STANDARD BARRIER CURB, (SEE NOTE 5)

CONSTRUCTION JOINT BETWEEN RAMPS AND BACK CURB

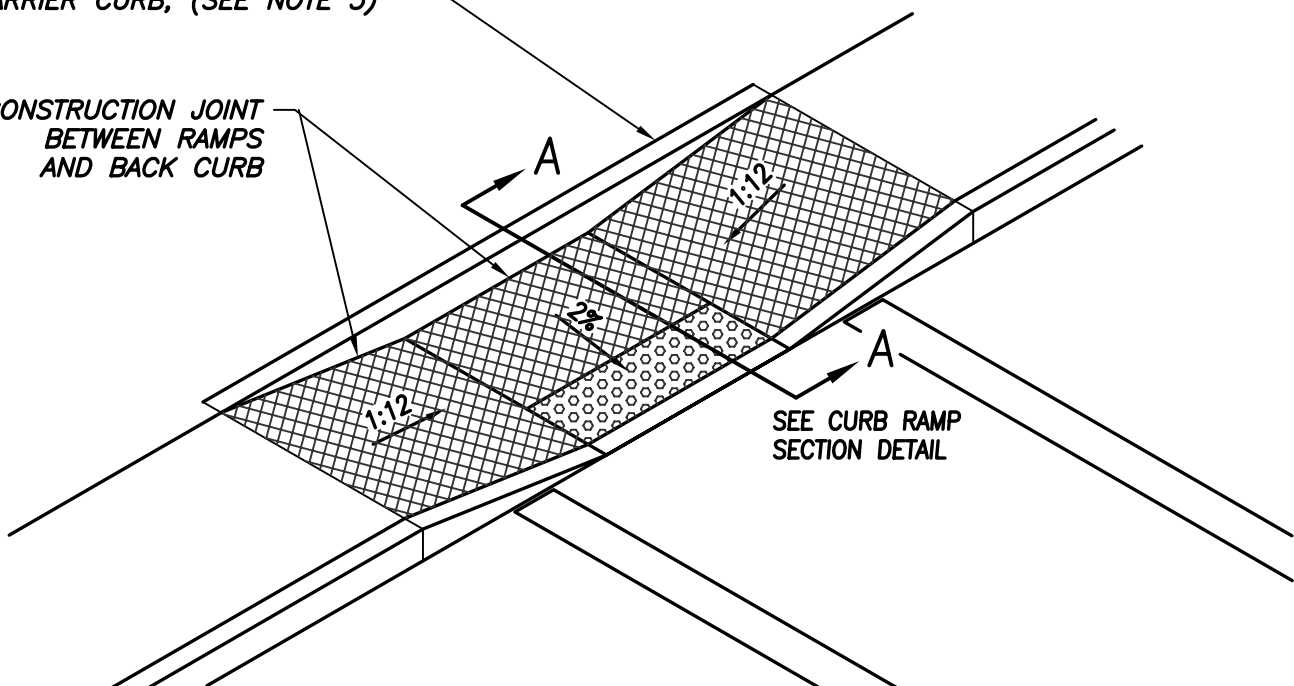

**CURB RAMP – TYPE 2**

NTS