


APPROVED HYDRANTS
 MEULLER SUPER CENTURION
 CLOW MEDALLION
 KENNEDY GUARDIAN
 AMERICAN AVK SERIES 2780

NOTES:

1. FIRE HYDRANT INSTALLATIONS SHALL BE INSPECTED PRIOR TO BACKFILLING.
2. FIRE HYDRANTS SHALL BE POWDER COATED FROM THE MANUFACTURE, YELLOW IN THE RIGH OF WAY AND RED FOR PRIVATE PROPERTY.
3. 36" MINIMUM CLEARANCE ON ALL SIDES (MAY INCLUDE SIDEWALK), 20"MINIMUM ONLY ON CURB SIDE.

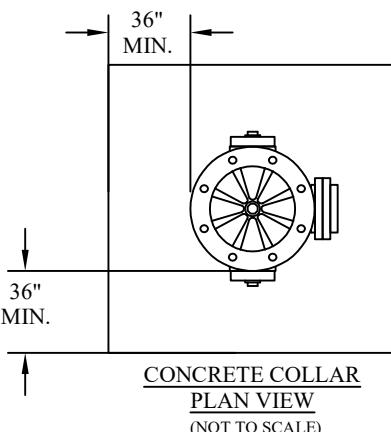

STANDARD FIRE HYDRANT ASSEMBLY

DATE: December 2023

DETAIL NO.
W40